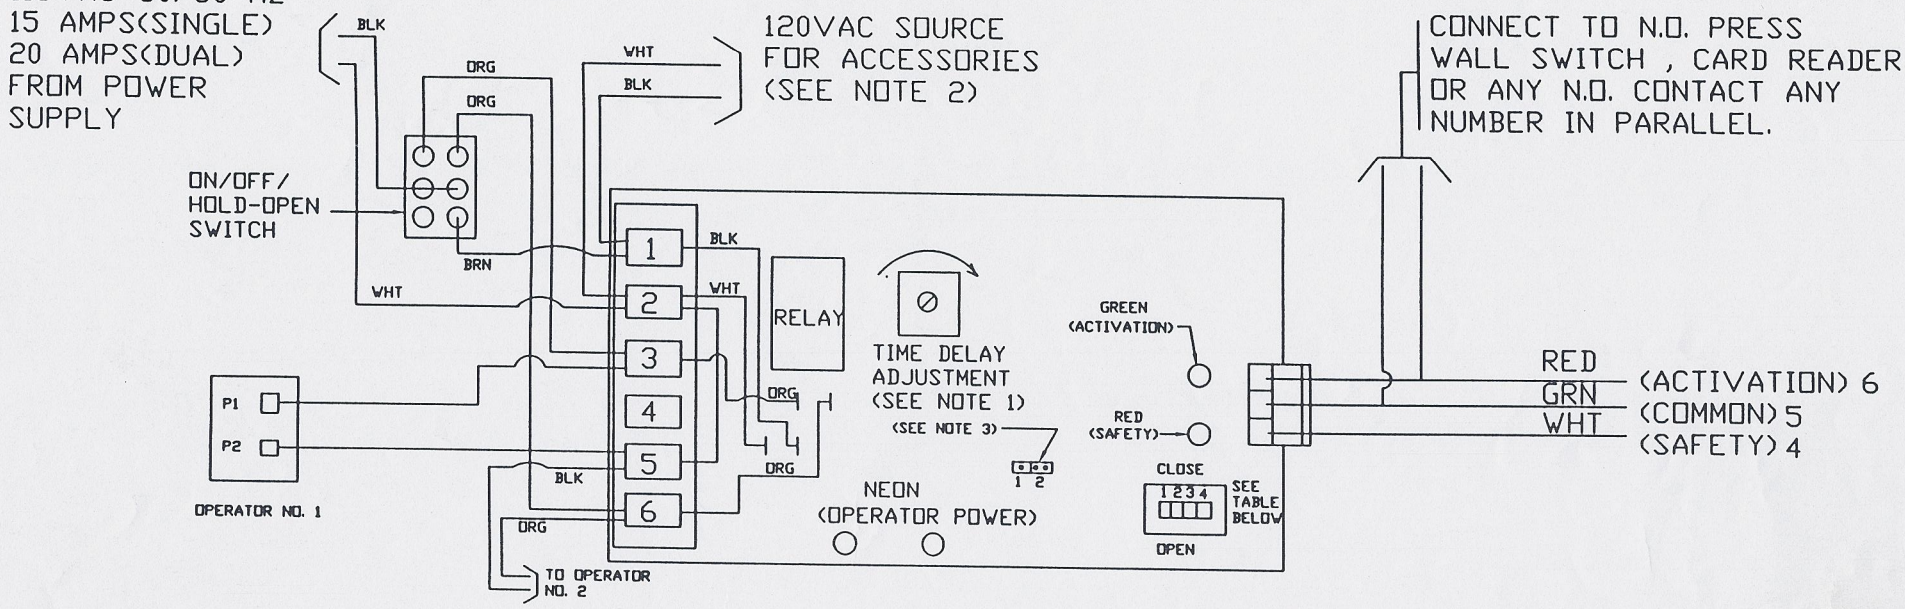

NOTES:
1. TO USE CONTROL IN RATCHET MODE, TURN TIME DELAY TRIMPOT FULLY COUNTER CLOCKWISE.
2. FOR ACCESSORIES, BLACK AND WHITE JUMPER WIRES ARE PROVIDED TO CONNECT TO SEPERATE TRANSFORMER.
3. FOR SAFETY TIME DELAY RESET, PUT THE JUMPER IN POSITION 2. FOR NORMAL TIME DELAY ON SAFETY CIRCUIT USE JUMPER IN POSITION 1.

SWITCH	1	2	3	4
STANDARD TIME DELAY	CLOSE	OPEN	OPEN	OPEN
* RATCHET ONLY	OPEN	CLOSE	OPEN	CLOSE
* RATCHET W/TIME OUT	OPEN	CLOSE	CLOSE	CLOSE

* SEE NOTE 1

"B" CONTROL

TEMP. NO. WD-STD-1

DATE: 3/31/94

DESCRIPTION: TM TIME DELAY W/LED's

STANDARD CONTROL FOR HYDRAULIC OPERATORS

KM AUTOMATED ENTRANCE SYSTEMS

KM SYSTEMS, INC.
4916 STARCREST DRIVE (28110)
P.O. BOX 3099
MONROE, NC 28111-3099 U.S.A.